



SANITARY SEWER CONSTRUCTION NOTES

1. ALL CONSTRUCTION SHALL CONFORM TO THE CURRENT STANDARDS AND SPECIFICATIONS OF THE LOCAL UNIT OF GOVERNMENT AND THE WATER RESOURCES COMMISSIONER (WRC). ALL SANITARY SEWER CONSTRUCTION SHALL HAVE FULL-TIME INSPECTION SUPERVISED BY A STATE OF MICHIGAN LICENSED PROFESSIONAL ENGINEER PROVIDED BY, OR CAUSED TO BE PROVIDED BY, THE LOCAL UNIT OF GOVERNMENT.
2. AT ALL CONNECTIONS TO WRC SEWERS OF EXTENSIONS, AND BEFORE START OF CONSTRUCTION, THE CONTRACTOR MUST OBTAIN A SEWER INSPECTION PERMIT ISSUED BY WRC. GRAVITY SEWER PERMIT CHARGES ARE \$250 FOR EACH CONNECTION PLUS \$25 FOR EACH MANHOLE CONSTRUCTED. PRESSURE SEWER PERMIT CHARGES ARE \$250 PER 2,480 L.F. OF FORCE MAIN WITH A MINIMUM PERMIT FEE OF \$250. FAILURE TO PASS ANY TEST SEGMENT WILL RESULT IN AN ADDITIONAL CHARGE TO THE CONTRACTOR FOR EACH RETEST, IN ACCORDANCE WITH THE ABOVE PRICE SCHEDULE. THE CONTRACTOR SHALL ALSO HAVE POSTED WITH WRC A \$5,000 SURETY BOND AND \$500 CASH DEPOSIT. THE CONTRACTOR SHALL NOTIFY THE LOCAL UNIT OF GOVERNMENT AND WRC (248-858-1105) 24 HOURS PRIOR TO THE BEGINNING OF ANY CONSTRUCTION. FINAL ACCEPTANCE TESTS MUST BE WITNESSED BY COUNTY PERSONNEL AND MUST BE SCHEDULED BY MUNICIPALITY OR ITS CONSULTANT IN ADVANCE WITH 24 HOUR NOTICE AT 248-858-1105.
3. NO SEWER INSTALLATION SHALL HAVE AN INFILTRATION EXCEEDING 100 GALLONS PER INCH DIAMETER PER MILE OF PIPE IN A 24 HOUR PERIOD, AND NO SINGLE RUN OF SEWER BETWEEN MANHOLES SHALL EXCEED 100 GALLONS PER INCH DIAMETER PER MILE. AIR TESTS IN LIEU OF INFILTRATION TESTS SHALL BE AS SPECIFIED IN THE WATER RESOURCES COMMISSIONER STANDARDS. ONLY PIPE AND PIPE JOINTS APPROVED BY WRC MAY BE USED FOR SANITARY SEWER CONSTRUCTION.
4. LOCATED IN THE FIRST MANHOLE UPSTREAM FROM THE POINT OF ALL CONNECTIONS TO AN EXISTING WRC SEWER, OR EXTENSION THERETO, A TEMPORARY 12-INCH DEEP SUMP SHALL BE PROVIDED IN THE FIRST MANHOLE ABOVE THE CONNECTION WHICH WILL BE FILLED IN AFTER SUCCESSFUL COMPLETION OF ANY ACCEPTANCE TEST UP TO THE STANDARD FILLET PROVIDED FOR THE FLOW CHANNEL. A WATERTIGHT BULKHEAD SHALL BE PROVIDED ON THE DOWNSTREAM SIDE OF THE SUMP MANHOLE.
5. AT ALL TIMES WHEN LAYING OF NEW PIPE IS NOT ACTUALLY IN PROGRESS, THE UPSTREAM OPEN END OF THE PIPE SHALL BE CLOSED BY TEMPORARY WATERTIGHT PLUGS OR BY OTHER APPROVED MEANS. IF WATER IS IN THE TRENCH WHEN WORK IS RESUMED, THE PLUG SHALL NOT BE REMOVED UNTIL THE DANGER OF WATER ENTERING THE PIPE HAS PASSED.
6. ALL BUILDING LEADS AND RISERS SHALL BE SIX INCH SDR 23.5 ABS PIPE WITH CHEMICALLY FUSED JOINTS OR AN APPROVED EQUAL PIPE AND JOINT. BUILDING LEADS TO BE FURNISHED WITH REMOVABLE AIRTIGHT AND WATERTIGHT STOPPERS.
7. ALL RIGID SEWER PIPE SHALL BE INSTALLED IN CLASS "B" BEDDING OR BETTER. ALL FLEXIBLE, SEMI-FLEXIBLE, OR COMPOSITE SEWER PIPE SHALL BE INSTALLED IN CONFORMANCE TO WRC SPECIFICATIONS.
8. ALL NEW MANHOLES SHALL HAVE WRC APPROVED FLEXIBLE, WATERTIGHT SEALS WHERE PIPES PASS THROUGH WALLS. MANHOLES SHALL BE OF PRE CAST SECTIONS WITH MODIFIED GROOVE, TONGUE AND RUBBER GASKET TYPE JOINTS. PRE CAST MANHOLE CONE SECTIONS SHALL BE WRC APPROVED MODIFIED ECCENTRIC CONE TYPE. ALL MANHOLES SHALL BE PROVIDED WITH BOLTED, WATERTIGHT COVERS.
9. AT ALL CONNECTIONS TO MANHOLES ON WRC SEWERS, OR EXTENSIONS THERETO, DROP CONNECTIONS WILL BE REQUIRED WHEN THE DIFFERENCE IN INVERT ELEVATIONS EXCEEDS 18 INCHES.
10. TAPS TO EXISTING MANHOLES SHALL BE MADE BY CORING. THE CONTRACTOR SHALL PLACE A KOR-N-SEAL BOOT (OR WRC APPROVED EQUAL) AFTER CORING IS COMPLETED. BLIND DRILLING WILL ONLY BE PERMITTED IN LIEU OF CORING WITH PRIOR WRC APPROVAL.
11. MANHOLES CONSTRUCTED DIRECTLY ON WRC SEWERS SHALL BE PROVIDED WITH COVERS READING "WATER RESOURCES COMMISSIONER-SANITARY" IN RAISED LETTERS.
12. NO GROUND WATER, STORM WATER, CONSTRUCTION WATER, DOWN SPOUT DRAINAGE OR WEEP TILE DRAINAGE SHALL BE ALLOWED TO ENTER ANY SANITARY SEWER INSTALLATION.
13. PRIOR TO ANY EXCAVATION, THE CONTRACTOR SHALL TELEPHONE MISS DIG (800-482-7171) FOR THE LOCATION OF UNDERGROUND PIPELINE AND CABLE FACILITIES AND SHALL ALSO NOTIFY REPRESENTATIVES OF OTHER UTILITIES LOCATED IN THE VICINITY OF THE WORK.
14. AN 18 INCH MINIMUM VERTICAL SEPARATION AND A 10 FOOT MINIMUM HORIZONTAL SEPARATION MUST BE MAINTAINED BETWEEN SANITARY SEWER AND WATER MAIN.
15. NEW MANHOLES BUILT OVER AN EXISTING SANITARY SEWER SHALL HAVE MONOLITHIC POURED BOTTOMS.
16. IF THE STRUCTURE FALLS WITHIN THE ROADBED OF A GRAVEL ROAD OR WITHIN THE UNPAVED SHOULDER OF A PAVED ROAD, THE COVER SHALL BE SIX (6") INCHES BELOW THE FINISHED GRAVEL SURFACE.

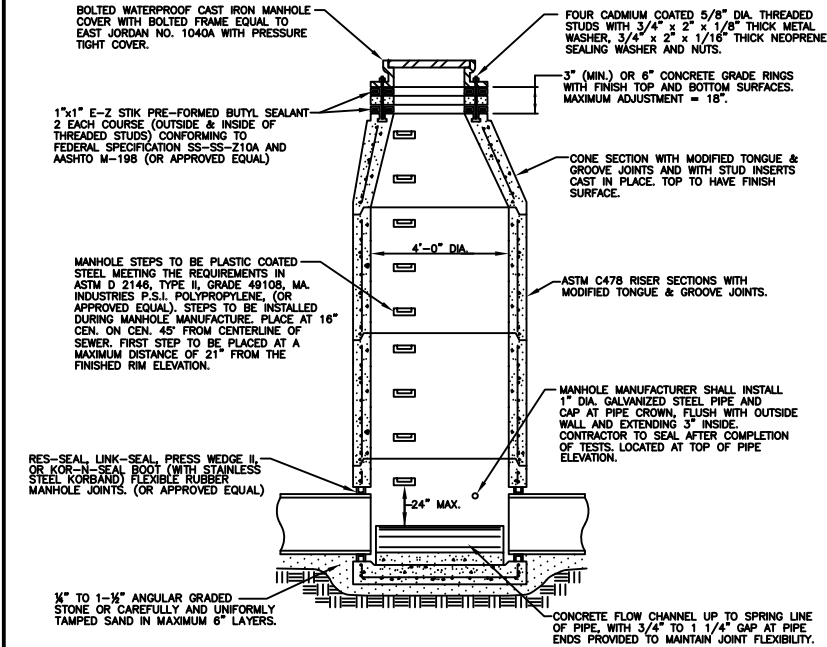


STANDARD MANHOLE

MAX. PIPE SIZE FOR STRAIGHT THRU INSTALLATION	MAX. PIPE SIZE FOR RIGHT ANGLE INSTALLATION
24"	18"

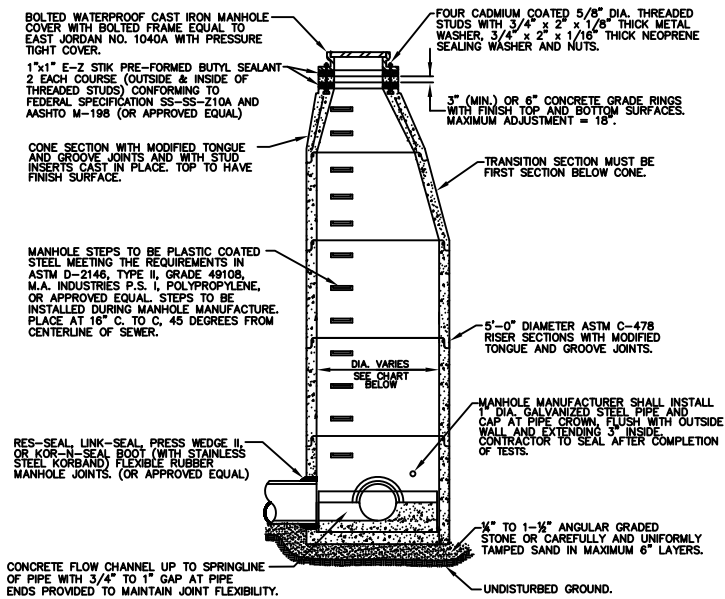


STANDARD OVERSIZED MANHOLE

MANHOLE SIZING CHART		
MANHOLE DIAMETER	MAX. PIPE SIZE FOR STRAIGHT THRU INST.	MAX. PIPE SIZE FOR RIGHT ANGLE INST.
5'	36"	24"
6'	42"	36"
7'	60"	42"

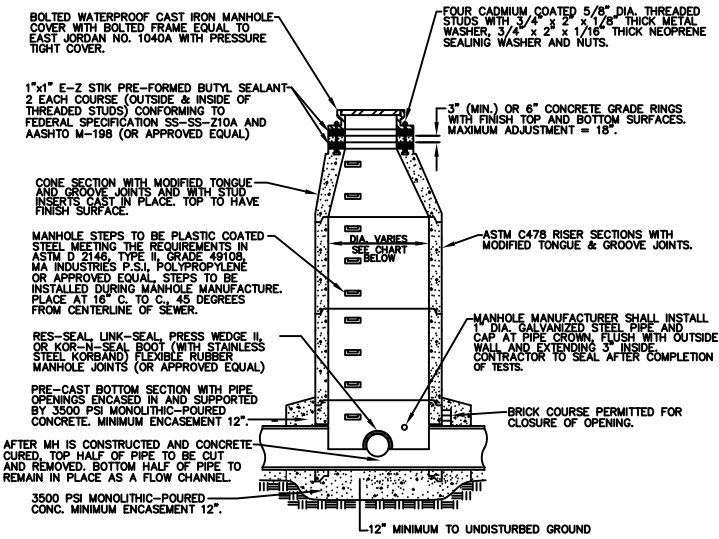


MANHOLE CONSTRUCTED OVER EXISTING SEWER

MANHOLE SIZING CHART	
MANHOLE DIAMETER	MAX. PIPE SIZE FOR STRAIGHT THRU INST.
4'	24"
5'	36"
6'	42"
7'	60"

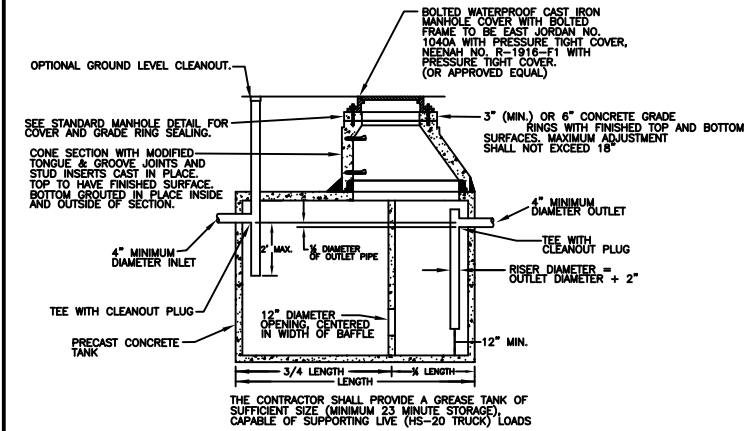


DOUBLE-COMPARTMENT GREASE INTERCEPTOR TANK FOR OUTLET PIPE BURIAL 42" AND DEEPER

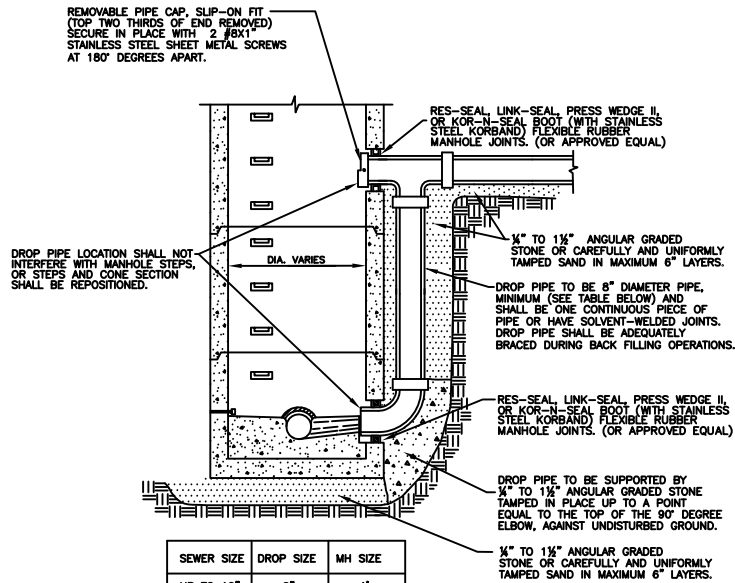

SEWER SIZE	DROP SIZE	MH SIZE
UP TO 10"	8"	4"
UP TO 18"	10"	4"
UP TO 30"	18"	5"

EXTERIOR DROP CONNECTION (REQUIRES ADVANCED APPROVAL BY WRC)

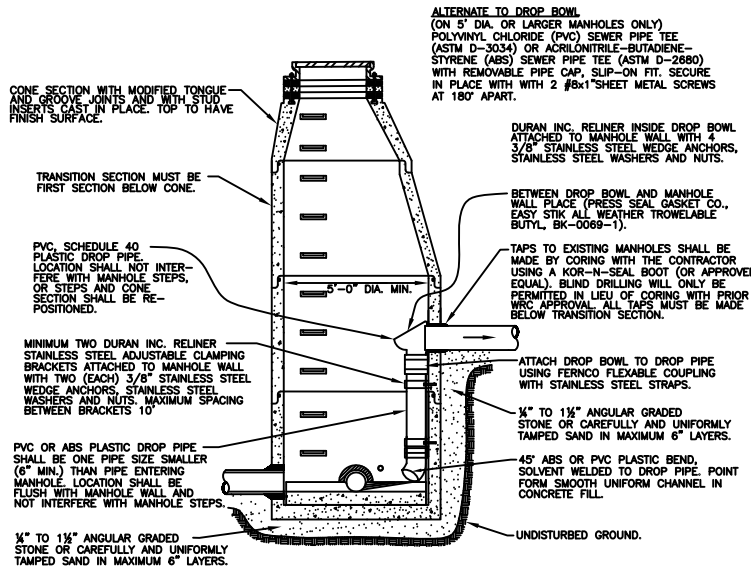

INTERIOR DROP CONNECTION

REVISION BLOCK			
Parcel Base / Source Data:	N/A		
Rev.	Rev.	Rev.	Description
1	1	1	1
2	2	2	2
3	3	3	3
4	4	4	4

SANITARY SEWER DETAILS AND NOTES

ORIG. DATE:	08/21/02
SCALE:	NO SCALE
DESIGNED BY:	WRC
DRAWN BY:	WRC Mapping



ONE PUBLIC WORKS DRIVE, BLDG 95 WEST WATERFORD, MICHIGAN 48326-1907
SHEET NO.: 1 of 2